

STRUCTURAL NOTES:

- THIS NON POROUS SYSTEM HAS BEEN VERIFIED FOR COMPLIANCE IN ACCORDANCE WITH THE 2020 (SEVENTH EDITION) OF THE FLORIDA BUILDING CODE (FBC) . THIS SYSTEM SHALL NOT BE INSTALLED IN THE HIGH VELOCITY HURRICANE ZONE (MIAMI-DADE/ BROWARD COUNTIES), NOR ESSENTIAL FACILITIES. THE ADEQUACY FOR IMPACT, DEFLECTION AND FATIGUE RESISTANCE HAS BEEN VERIFIED IN ACCORDANCE WITH THE ABOVE REFERENCED CODE, AND AS PER TAS 201, TAS 202 and TAS 203 PROTOCOLS AND ASTM E330-02, ASTM E1886-05 AND ASTM E1996-05. SEE LIST OF REPORTS ON SHEET 1/2.
- DESIGN PRESSURE REQUIREMENTS OF A SPECIFIC SITE SHALL BE DETERMINED BY OTHERS IN CONFORMANCE TO SECTION 1609 OF THE FBC FOR A BASIC WIND SPEED (ALLOWABLE STRESS DESIGN) AS REQUIRED BY THE JURISDICTION WHERE THE SYSTEM WILL BE INSTALLED. ULTIMATE DESIGN LOADS (UD) DETERMINED BY ASCE 7-16 SHALL BE REDUCED TO ALLOWABLE STRESS DESIGN LOADS (ASD) BY MULTIPLYING THE UD BY 0.6. TO COMPARE THEM TO THE ASD PRESSURE RATINGS SHOWN ON SHEET 1 AND 2. USE OF DIRECTIONALITY FACTOR Kd=0.85 IS ALLOWED.
- IMPACT AND FATIGUE RESISTANCE HAS BEEN DETERMINED IN ACCORDANCE WITH THE FBC SECTION 1609.1.2 MISSILE TYPE "D" AS LISTED HEREIN.
- NO 33-1/3% INCREASE IN ALLOWABLE STRESS INCREASE HAS BEEN USED IN THE DESIGN OF THIS PRODUCT.
- THIS PRODUCT EVALUATION DOCUMENT (PED) DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. IF SITE CONDITIONS DEVIATE FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO BE USED IN CONJUNCTION WITH THIS DOCUMENT.
- THE CONTRACTOR AND / OR PERMIT HOLDER IS TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION OF THIS SYSTEM, INCLUDING VERIFYING THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND THE NEW SUPERIMPOSED LOADS SHOWN BELOW AND THE SOUNDNESS OF THE STRUCTURE WHERE THE SYSTEM IS TO BE ATTACHED TO INSURE PROPER ANCHORAGE.
- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA LICENSED ENGINEER OR ARCHITECT WHO WILL BECOME THE ENGINEER OF RECORD (EOR) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE PED ENGINEER OF RECORD, ACTING AS A DELEGATED ENGINEER TO THE PED ENGINEER SHALL SUBMIT TO THIS ENGINEER THE SITE SPECIFIC DRAWINGS FOR REVIEW.
- THIS PED SHALL BEAR THE DATE AND ORIGINAL SEAL OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.
- THIS SYSTEM MAY ALSO BE INSTALLED HORIZONTALLY FOLLOWING INSTALLATION DETAILS SHOWN HEREIN.
- THIS WIND ABATEMENT SYSTEM IS INTENDED FOR USE ONLY DURING HURRICANE OR OTHER TROPICAL STORM WARNINGS. SEASONAL OR PERMANENT INSTALLATION OR STORAGE OF THIS WIND ABATEMENT SYSTEM IN AREAS OF PROLONGED EXPOSURE TO DIRECT SUNLIGHT OR OTHER WEATHERING CONDITIONS MAY CAUSE MATERIAL DETERIORATION OR OTHERWISE INHIBIT THEIR ADEQUACY AS AN IMPACT RESISTANT SYSTEM.
- LIMITATIONS OF USE  
PER FBC 2020 NO MINIMUM SEPARATION FROM GLASS IS REQUIRED.  
THE MAXIMUM SIZE SHALL BE 60 PSF MAX. PRESSURE @216 INCHES MAXIMUM SPAN. SEE TABLES ON SHEET 1/2.
- RESERVED.
- ALL SCREWS TO BE STAINLESS STEEL 304 OR 316 SERIES OR CORROSION RESISTANT COATED CARBON STEEL WITH A 50 KSI YIELD STRENGTH AND A 90 KSI TENSILE STRENGTH.
- ALL BOLTS TO BE ASTM A307, GALVANIZED OR 304 SERIES STAINLESS STEEL WITH A MINIMUM 36 KSI YIELD STRENGTH.
- ANCHORS TO STRUCTURE (WALL / FLOOR / CEILING / SYSTEM) SHALL BE INSTALLED PER MANUFACTURERS' RECOMMENDATIONS AND AS FOLLOWS:
  - CONCRETE BLOCK MASONRY (ASTM C-90)  
TAPCON ANCHORS (ITW BUILDEX) OR PANELMATE MALE & FEMALE FASTENERS (ELCO TEXTRON) - 1/4 IN. DIA.  
I. MINIMUM EMBEDMENT INTO HOLLOW CONCRETE BLOCK MASONRY FOR TAPCON ANCHORS AND ELCO PANELMATES IS 1 1/4 IN., FILLED MASONRY EMBEDMENT IS 1 3/4". NO EMBEDMENT INTO STUCCO SHALL BE PERMITTED.  
II. PAVERS, BRICKS OR OTHER PRE-CAST PRODUCTS LOCATED ON THE EXISTING STRUCTURE WALL OR FLOOR SHALL HAVE ANCHORS OF SUFFICIENT LENGTH TO PROPERLY ATTACH TO THE PRIMARY STRUCTURE BEHIND IT.  
III. MINIMUM EDGE DISTANCE = 3.0"
  - POURED CONCRETE (f'c=3000 PSI MIN.)  
TAPCON ANCHORS (ITW BUILDEX) OR PANELMATE MALE & FEMALE FASTENERS (ELCO TEXTRON) - 1/4 IN. DIA.  
I. MINIMUM EMBEDMENT INTO POURED CONCRETE FOR TAPCON ANCHORS AND ELCO PANELMATES IS 1 3/4 IN. NO EMBEDMENT INTO STUCCO SHALL BE PERMITTED. SCREWS TO BE 1/4"-20 X 1 3/4" FOR STUCCO, 1 1/4" WITH NO STUCCO.  
II. PAVERS, BRICKS OR OTHER PRE-CAST PRODUCTS LOCATED ON THE EXISTING STRUCTURE WALL OR FLOOR SHALL HAVE ANCHORS OF SUFFICIENT LENGTH TO PROPERLY ATTACH TO THE PRIMARY STRUCTURE BEHIND IT.  
III. MINIMUM EDGE DISTANCE = 3.0"
  - WOOD (Nominal 2x4(min) "Southern Pine" SG=0.55 OR GREATER)  
TAPCON ANCHORS (ITW BUILDEX) DIA. OR PANELMATE MALE & FEMALE FASTENERS (ELCO TEXTRON) - 1/4 IN.  
I. MINIMUM EDGE DISTANCE = CENTER OF 2" NOMINAL LUMBER (APPROX. 3/4"). MINIMUM EMBEDMENT = 1-1/2"
- MAXIMUM DESIGN PRESSURE VERSUS PANEL SPAN SHOWN ON SHEET 1/2
- SCREEN PANEL'S MANUFACTURER LABEL SHALL BE PLACED ON A READILY AND VISIBLE LOCATION ON THE PANEL. ONE LABEL SHALL BE PLACED FOR EVERY OPENING. LABEL SHALL READ AS FOLLOWS:  
HURRICANE FABRIC LLC  
PO BOX 50153; CLAYTON, MO 63105  
FLORIDA PRODUCT APPROVAL NUMBER: FL-XXXX. OPENING NO.: XX
- THIS DOCUMENT IN ITS ENTIRETY WILL BE CONSIDERED INVALID IF IT IS ALTERED BY ANY MEANS.

RETENTION CLIP END CONNECTOR:

RHODIA ENGINEERING PLASTICS - POLYAMIDE 66

FABRIC SPECIFICATION:


FIBER CONTENT: TEXTILE FABRIC  
CONSTRUCTION: 20 X 20 WEAVE  
FINISH: RESIN COATED  
WEIGHT (ASTM D-3776): 9.0 -OZ/SQUARE YARD  
TENSILE STRENGTH (GRAB METHOD, ASTM D -4632): WARP - 570 lbs., WEFT - 570 lbs.  
BURST STRENGTH (ASTM D - 3786): 1,000 PSI  
ABRASION RESISTANCE (ASTM D -4886) 95% STRENGTH RETAINED

SEWING:

ONLY SEWING IS AT SPLICE

EDGES:

NO SEWING AT EDGES

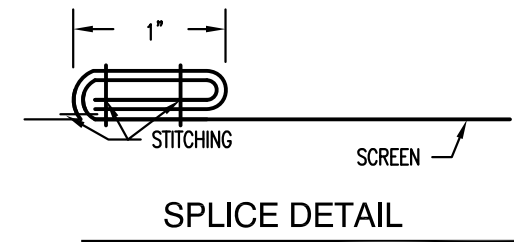

FASTENER SPACING OF A SINGLE UNIT SCREEN FOR ANY LENGTH ATTACHED WITH 3/8" DROP-IN ANCHOR WITH SIDEWALK BOLT (INCHES)

SCREEN SPAN	FILLED CMU (1900 PSI)				CONCRETE (4000 PSI)				HOLLOW CMU				TIMBER			
	PRESSURE (PSF)				PRESSURE (PSF)				PRESSURE (PSF)				PRESSURE (PSF)			
	60	50	40	30	60	50	40	30	60	50	40	30	60	50	40	30
4'-0"	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12
6'-0"	12	12	12	12	12	12	12	12	12	12	12	12	9	11	12	12
8'-0"	12	12	12	12	12	12	12	12	12	12	12	12	6	7	8	10
10'-0"	12	12	12	12	12	12	12	12	10	12	12	12	5	6	7	9
12'-0"	10	12	12	12	12	12	12	12	9	10	12	12	5	5	6	8
14'-0"	9	10	12	12	10	11	12	12	8	9	10	12	-	4	5	6
16'-0"	8	9	10	12	8	10	11	12	7	8	9	11	-	-	4	6
18'-0"	7	8	9	11	8	9	10	12	6	7	8	10	-	-	4	5

FASTENER SPACING OF A SINGLE UNIT SCREEN FOR ANY LENGTH ATTACHED WITH 1/4" ELCO PANELMATE PRO, MALE & FEMALE (INCHES)

SCREEN SPAN	FILLED CMU (1900 PSI)				CONCRETE (4000 PSI)				HOLLOW CMU				TIMBER			
	PRESSURE (PSF)				PRESSURE (PSF)				PRESSURE (PSF)				PRESSURE (PSF)			
	60	50	40	30	60	50	40	30	60	50	40	30	60	50	40	30
4'-0"	12	12	12	12	12	12	12	12	11	12	12	12	10	11	12	12
6'-0"	11	12	12	12	12	12	12	12	8	9	10	12	7	8	9	12
8'-0"	7	8	10	12	8	9	11	12	5	6	7	9	5	5	6	8
10'-0"	6	7	8	10	7	8	9	11	4	5	6	7	-	4	5	6
12'-0"	5	6	7	9	6	7	8	9	-	4	5	6	-	-	4	6
14'-0"	4	5	6	7	5	5	6	8	-	-	4	5	-	-	-	5
16'-0"	-	5	5	6	4	5	6	7	-	-	-	5	-	-	-	4
18'-0"	-	-	5	6	-	4	5	6	-	-	-	4	-	-	-	-

EVALUATION BASED ON:  
FENESTRATION TESTING LABORATORY, INC

LAB NO.: 6418 DATED 12/7/2010

ASTM E330-02 - UNIFORM STATIC LOADS  
ASTM E1886-05 & ASTM E1996-05 - LARGE MISSILE TYPE "D" IMPACT RESISTANCE & CYCLIC LOADING PERFORMANCE

LAB NO.: 5804 DATED 01/13/2009

TAS 202 - UNIFORM STATIC LOADS  
TAS 201, TAS 202 - LARGE MISSILE IMPACT RESISTANCE & CYCLIC LOADING PERFORMANCE

LIST OF REPORTS

John H. Kampmann Jr., PE  
FL License #: 47516  
DATE:

WWW.MEENGINEERS.COM CA #6752  
**ME** ENGINEERS, INC.  
 5656 Lawton Drive  
 Sarasota, Florida 34233  
 (941) 922-3854 CA-6072


HURRICANE FABRIC LLC  
 PO BOX 50153  
 CLAYTON, MO 63105  
 PHONE: (239)899-0099  
 WWW.HURRICANEFABRIC.COM

ASTRO GUARD  
 Wind Abatement System

2020 FBC (NON-HIGH VELOCITY HURRICANE ZONE) 7TH EDITION


Project Name:  
 Description:  
 Drawn: JK  
 Project #: 20-0226  
 Scale: NTS  
 Date: 10/3/20  
 Sheet No.:

1 / 2

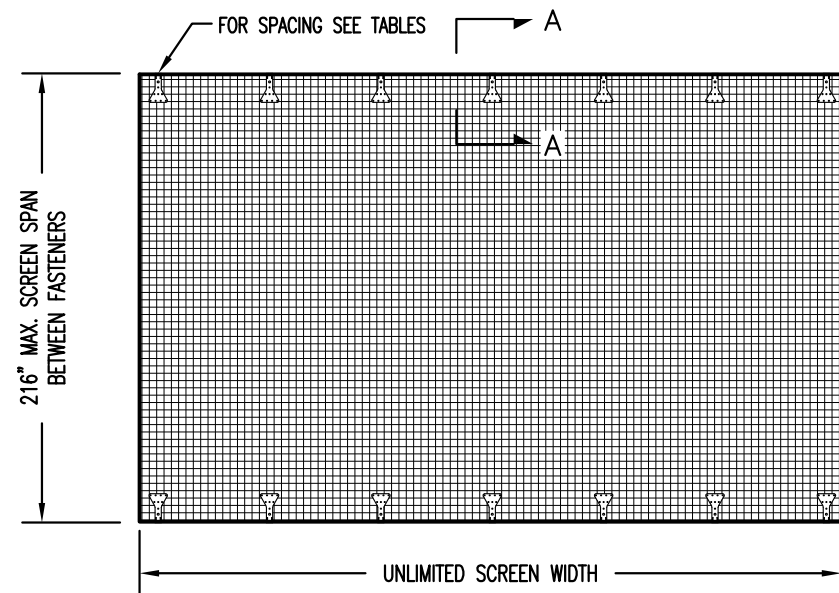


**TYPICAL TWO-SIDED INSTALLATION**  
VERTICAL OR HORIZONTAL INSTALLATION - N.T.S.

NOTE:  
PANELS CAN BE ATTACHED ON THREE OR FOUR SIDES.  
FOR FOUR SIDE ATTACHMENT THE SPAN IS IN THE SHORT DIMENSION BETWEEN FASTENERS

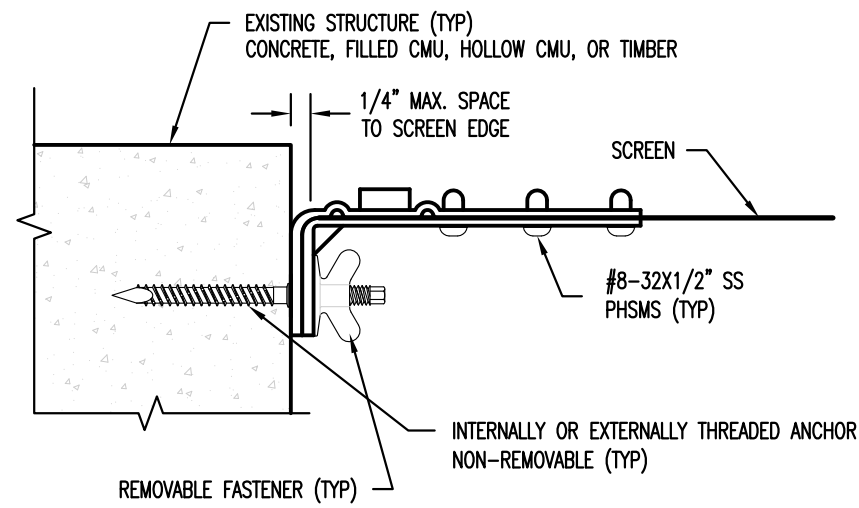

**SECTION A-A (OPTION 1)**  
INSIDE MOUNT INSTALLATION - N.T.S.

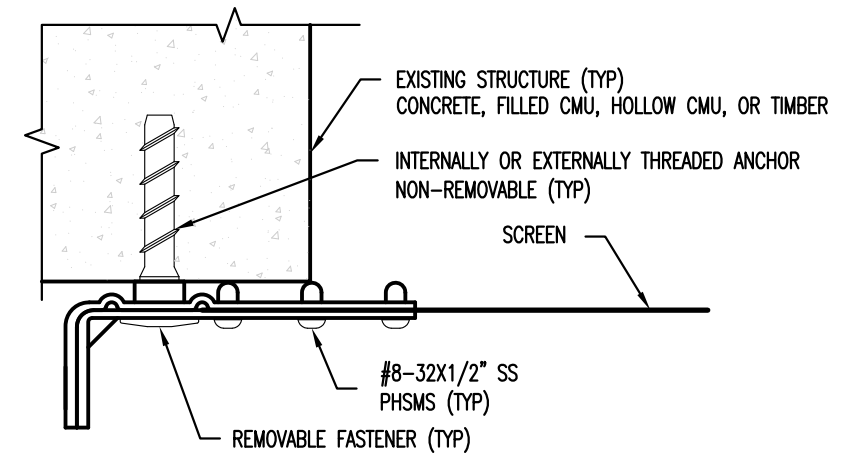


**SECTION A-A (OPTION 2)**  
OUTSIDE MOUNT INSTALLATION - N.T.S.

**LOADS ON EXISTING STRUCTURE FROM SCREEN SYSTEM**  
TX = PARALLEL LOADS (PLF)


SPAN (INCHES)	PRESSURE (PSF)						
	60	55	50	45	40	35	30
216	1134	1070	1004	936	866	792	714
192	1020	962	903	842	778	712	642
168	905	854	801	747	690	631	570
144	744	702	659	614	568	519	469
120	651	615	577	538	497	455	410
96	553	521	489	456	422	386	348
72	353	333	312	291	269	246	222
48	254	240	225	210	194	178	160

**LOADS ON EXISTING STRUCTURE FROM SCREEN SYSTEM**  
TY = PERPENDICULAR LOADS (PLF)


SPAN (INCHES)	PRESSURE (PSF)						
	60	55	50	45	40	35	30
216	540	495	450	405	360	315	270
192	480	440	400	360	320	280	240
168	420	385	350	315	280	245	210
144	360	330	300	270	240	210	180
120	300	275	250	225	200	175	150
96	240	220	200	180	160	140	120
72	180	165	150	135	120	105	90
48	120	110	100	90	80	70	60

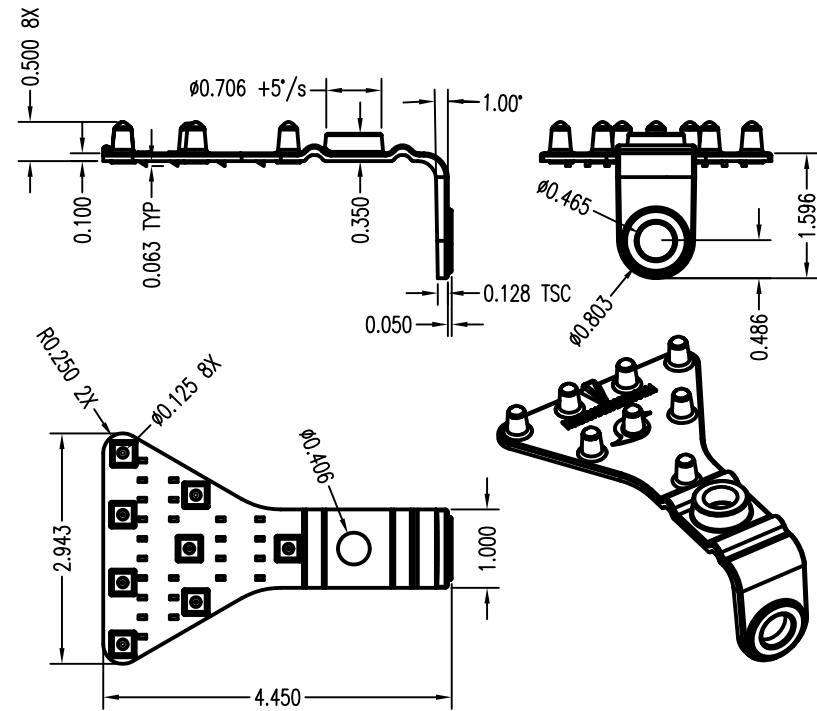

**BOTTOM MOUNTING CLIP DETAILS**  
INSIDE OR OUTSIDE MOUNT INSTALLATION - N.T.S.

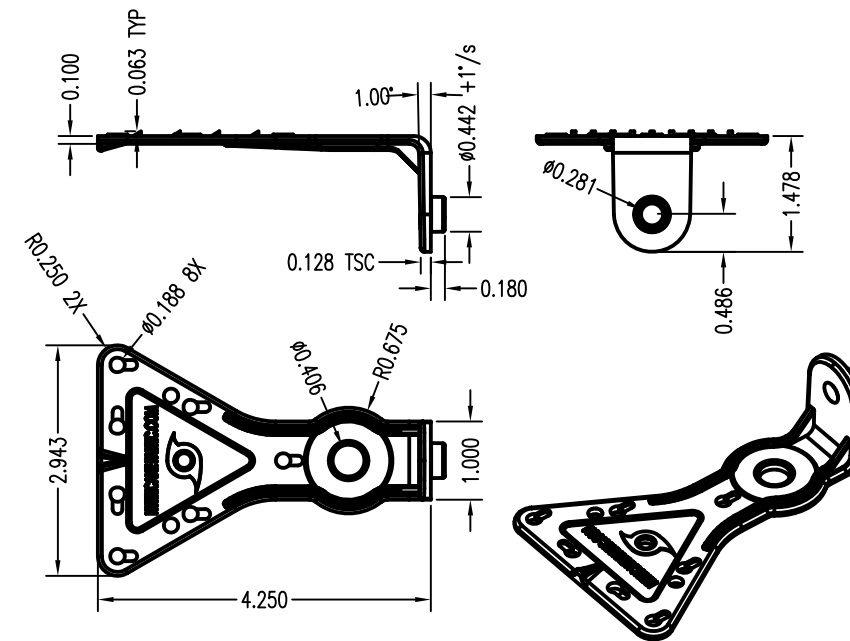

**TOP MOUNTING CLIP DETAILS**  
INSIDE OR OUTSIDE MOUNT INSTALLATION - N.T.S.

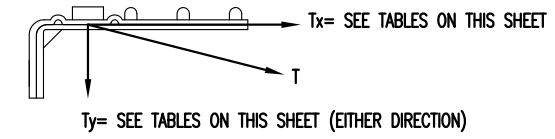

CA #6752  
WWW.MEAENGINEERS.COM

**MEA**  
ENGINEERS, INC.

5656 Lawton Drive  
Sarasota, Florida 34233  
(941) 922-3854 CA-6072

REV.	DESCRIPTION
1	xx/xx/xx-RESERVED

HURRICANE FABRIC LLC  
PO BOX 50153  
CLAYTON, MO 63105  
PHONE: (239)699-0099  
WWW.HURRICANEFABRIC.COM

2020 FBC (NON-HIGH VELOCITY HURRICANE ZONE) 7TH EDITION

Project Name:  
**ASTRO GUARD**  
Wind Abatement System

Drawn: JK  
Project #: 20-0226  
Scale: NTS  
Date: 10/3/20  
Sheet No.:

John H. Kampmann Jr., PE  
FL License #: 47516  
DATE:



CIVIL • STRUCTURAL • MARINE  
COASTAL • GEOTECHNICAL

www.meaengineers.com

## **PRODUCT EVALUATION REPORT**

**REPORT NO.:** 20-0226  
**DATE:** October 3, 2020  
**PRODUCT CATEGORY:** Impact Protective Systems  
**PRODUCT SUB-CATEGORY:** Removable  
**PRODUCT NAME:** Astro Guard Wind Abatement System  
**MANUFACTURER:** HurricaneFabric LLC  
PO Box 50153  
Clayton, MO 63105

### **SCOPE OF EVALUATION:**

This is a Product Evaluation Report issued by **John H. Kampmann Jr., PE** (FBC Org. No.: ANE2480) to **HurricaneFabric.com, LLC**, manufacturer, in accordance with the requirements of the Florida Department of Business and Professional Regulation (Florida Building Commission), Rule Chapter No.: 61G20-3, Method 1 (d).

All products listed above have been tested and/or evaluated as described herein to verify compliance with the 2020 Seventh edition of the Florida Building Code, and to verify that the product is for the purpose intended, at least equivalent to that required by the Code.

This Product Evaluation Report shall be subject to review and revision following Florida Building Code modifications or revisions.

### **EVIDENCE SUBMITTED:**

#### **PRODUCT EVALUATION DOCUMENTS**

MEEA Engineers, Inc. Drawing #20-0226 titled "Astro Guard Wind Abatement System", Sheets 1 and 2, prepared by John H. Kampmann Jr., PE; signed and sealed by John H. Kampmann Jr., PE; Dated 10/3/20, is an integral part of this Evaluation Report.

#### **TEST REPORTS**

Uniform Static Loads per Protocol TAS 202 as per section 1609.1.2 of the Florida Building Code. Test Report prepared by Fenestration Testing Lab, Lab No. 5804, Dated 01/13/09 for Florida State Approval.

Uniform Static Loads per ASTM E330 as per section 1609.1.2 of the Florida Building Code. Test Report prepared by Fenestration Testing Lab, Lab No. 6418, Dated 12/07/10 for Florida State Approval.

Large Missile Impact Resistance and Cyclic Loading Performance per Protocol TAS 201 and TAS 203 as per section 1609.1.2 of the Florida Building Code. Test Report

prepared by Fenestration Testing Lab, Lab No. 5804, Dated 01/13/09 for Florida State Approval.

Large Missile Impact Resistance and Cyclic Loading Performance per ASTM E1886 and ASTM E1996 Protocols as per section 1609.1.2 of the Florida Building Code. Test Report prepared by Fenestration Testing Lab, Lab No. 6418, Dated 12/07/10 for Florida State Approval.

Note: Lab Reports Signed and Sealed on Dates noted by Marlin Brinson, PE.

### **STRUCTURAL ENGINEERING CALCULATIONS**

Structural Engineering Calculations have been prepared which evaluate the product for maximum screen length vs. design wind load; maximum anchor spacing vs. design wind load and screen length based on rational and comparative analysis, per section 1609 of the Florida Building Code (Non-HVHZ).

### **MISSILE IMPACT RESISTANCE:**

Large Missile Impact, per section 1609.1.2 of the Florida Building Code, as per Protocol TAS 201 and missile type D (Basic Protection), as per ASTM E1886 and ASTM E1996 Standard.

### **WIND LOAD RESISTANCE:**

The product(s) listed above have been designed to resist wind loads as indicated in the span schedule(s) on its respective Product Evaluation Document – Drawing noted above.

### **INSTALLATION:**

The product(s) listed above shall be installed in strict compliance as indicated in its respective Product Evaluation Document – Drawing noted above.

### **MATERIAL CHARACTERISTICS AND SPECIFICATIONS:**

The product(s) listed above shall be installed in strict compliance as indicated in its respective Product Evaluation Document – Drawing noted above.

### **LIMITATIONS AND CONDITIONS OF USE:**

The product(s) listed above shall be installed in strict compliance as indicated in its respective Product Evaluation Document – Drawing noted above.

Conditions which are not indicated or accounted for in the Product Evaluation Document shall be designed for on a site-specific basis by a Florida Licensed Professional Engineer.

All components which are permanently installed shall be protected against corrosion, contamination and other such damage at all times. Periodic inspection is strongly recommended to insure its continued safe use.

The product(s) listed above **SHALL NOT** be installed within the HIGH VELOCITY HURRICANE ZONES as defined in section 1620.2 of the Florida Building Code and shall only be installed within wind zones 1,2 or 3, as defined the ASTM E1996 Standard.

The product(s) listed above shall only be installed onto Concrete Block, Poured Concrete and Wood Frame Structures.